




Anhang 8 der Anlage 6

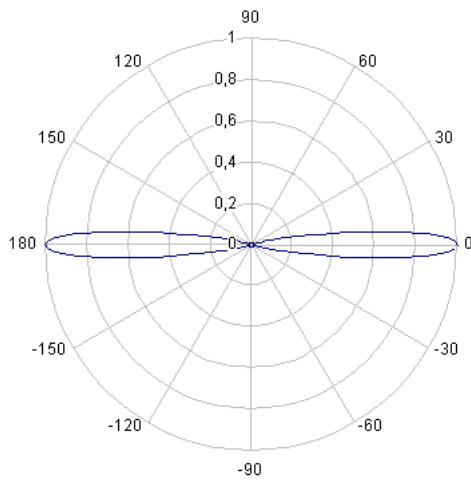


050PA00

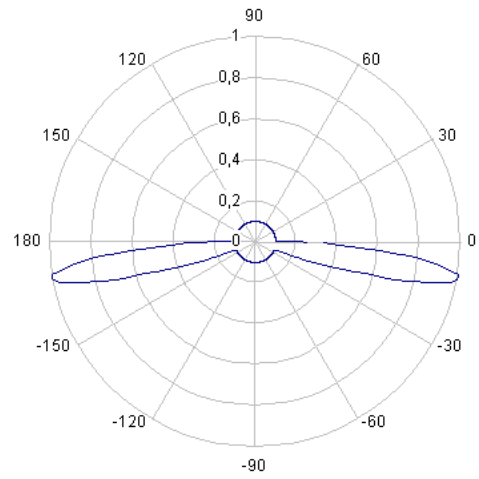

050PK10

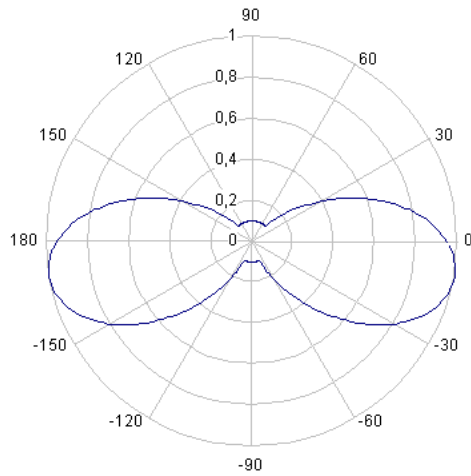

250PK10

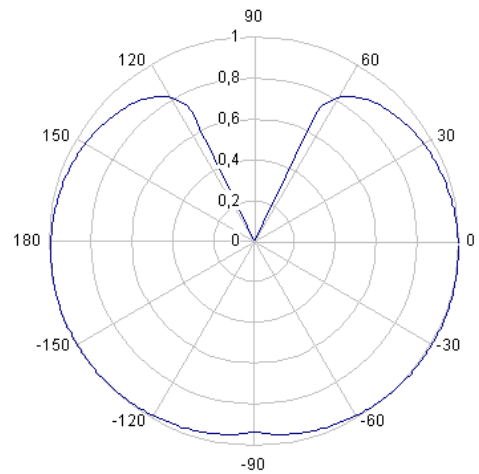

890PZ00

Nu- merischer Wert	Nebenkeulendämpfung	
90	0,9 =	-1 dB
80	0,8 =	-2 dB
70	0,7 =	-3 dB
60	0,6 =	-4,5 dB
50	0,5 =	-6 dB
40	0,4 =	-8 dB
30	0,3 =	-10,5 dB
20	0,2 =	-14,5 dB
10	0,1 =	-20 dB
05	0,05 =	-26 dB